
Approved for Site Use By Design Manager

C03

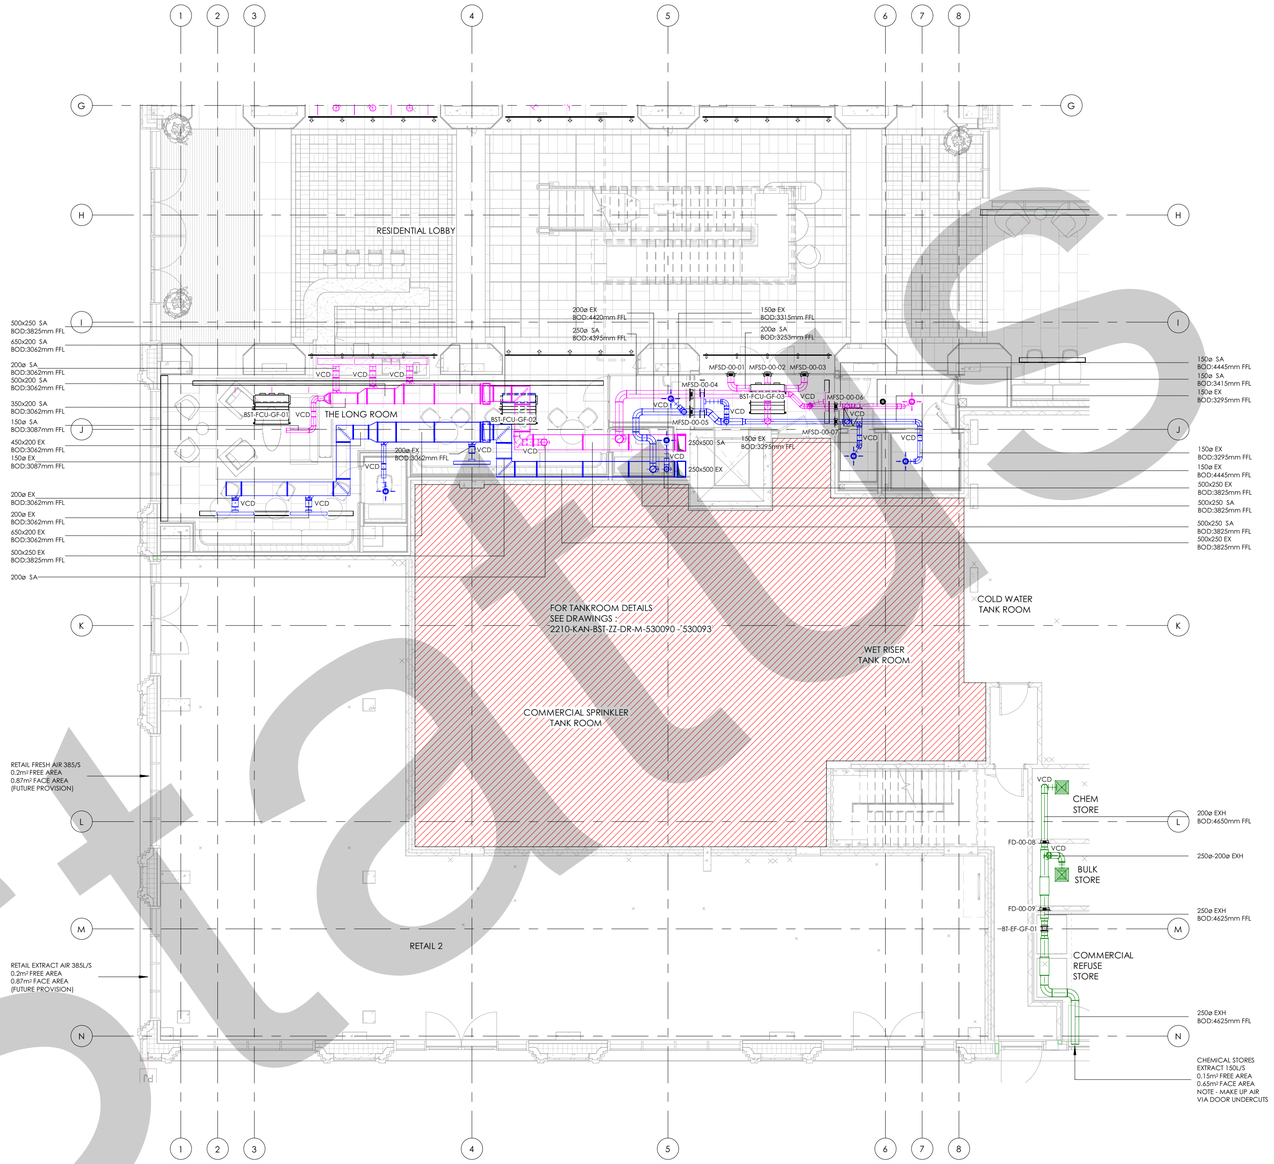

Ventilation Legend

	EXHAUST AIR
	EXTRACT AIR
	FRESH AIR
	KITCHEN EXTRACT
	SUPPLY AIR
	TOILET EXTRACT
	EXTRACT AIR VALVE
	SUPPLY AIR VALVE
	ATTENUATOR
	PLENUM WITH FLOWBAR
VCD	VOLUME CONTROL DAMPER
FD	FIRE DAMPER
MFSD	MOTORISED FIRE AND SMOKE DAMPER

Notes

1. FOR BLOCK S VENTILATION SERVICES SCHEMATIC REFER TO DRAWING NUMBER **2210-KAN-BS-ZZ-DR-M-571001**

FOR BLOCK S&T VENTILATION SERVICES SCHEMATIC REFER TO DRAWING NUMBER **2210-KAN-BST-ZZ-DR-M-573001**

FOR BLOCK T VENTILATION SERVICES SCHEMATIC REFER TO DRAWING NUMBER **2210-KAN-BT-ZZ-DR-M-572001**

REV	DATE	BY	CHK	DESCRIPTION
C03	24/06/25	DH	AA	Updated for construction
C02	05/03/25	DH	AA	Revised as per comments. Fire Damper references added.
C01	20/11/24	DH	AA	Construction Issue
P01	28/08/24	DH	AA	First Issue

kane
028 437 78484
www.kanegroup.co.uk
Unit 18-19 Scarva Rd Industrial Estate, Banbridge BT32 3QD

BUILDERS SISK CONTRACTORS Established 1859

Job Title

Bermondsey S&T

Drawing Title

Block S&T
Ventilation Services Layout
Ground Floor Sheet 02

Client

Greystar

Architect

AFK

Drawn	Checked	Approved	First Issue Date
DH	AA	JM	24/06/25

Scale @ A1	Drawing Status	PAS
1:100	For Construction	A5

Project	Originator	Zone	Level	Type	Role	Number	Rev
2210	KAN	BST	GF	DR	M	570002	C03

Stage A